


Fire Hydrant Requirements



A **3-foot clear space** shall be maintained around the circumference of fire hydrants... unobstructed access to fire hydrants shall be maintained at all times.
(IFC Section 507)

Right

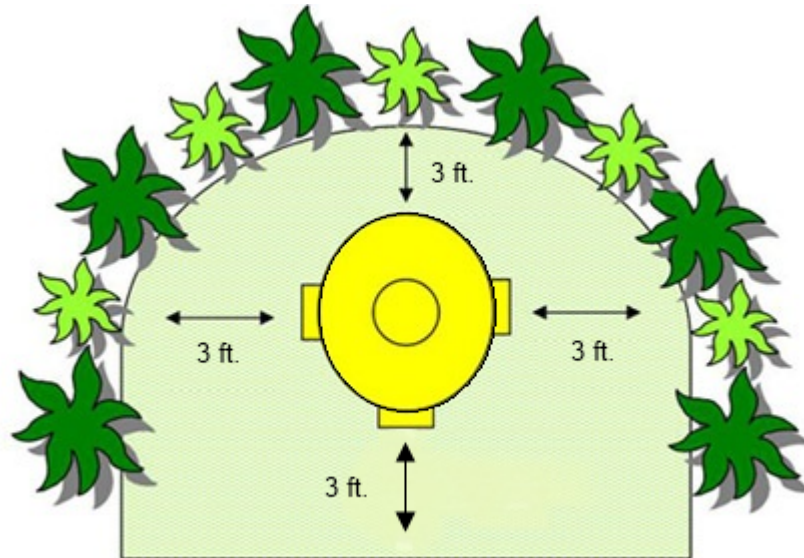

Wrong

